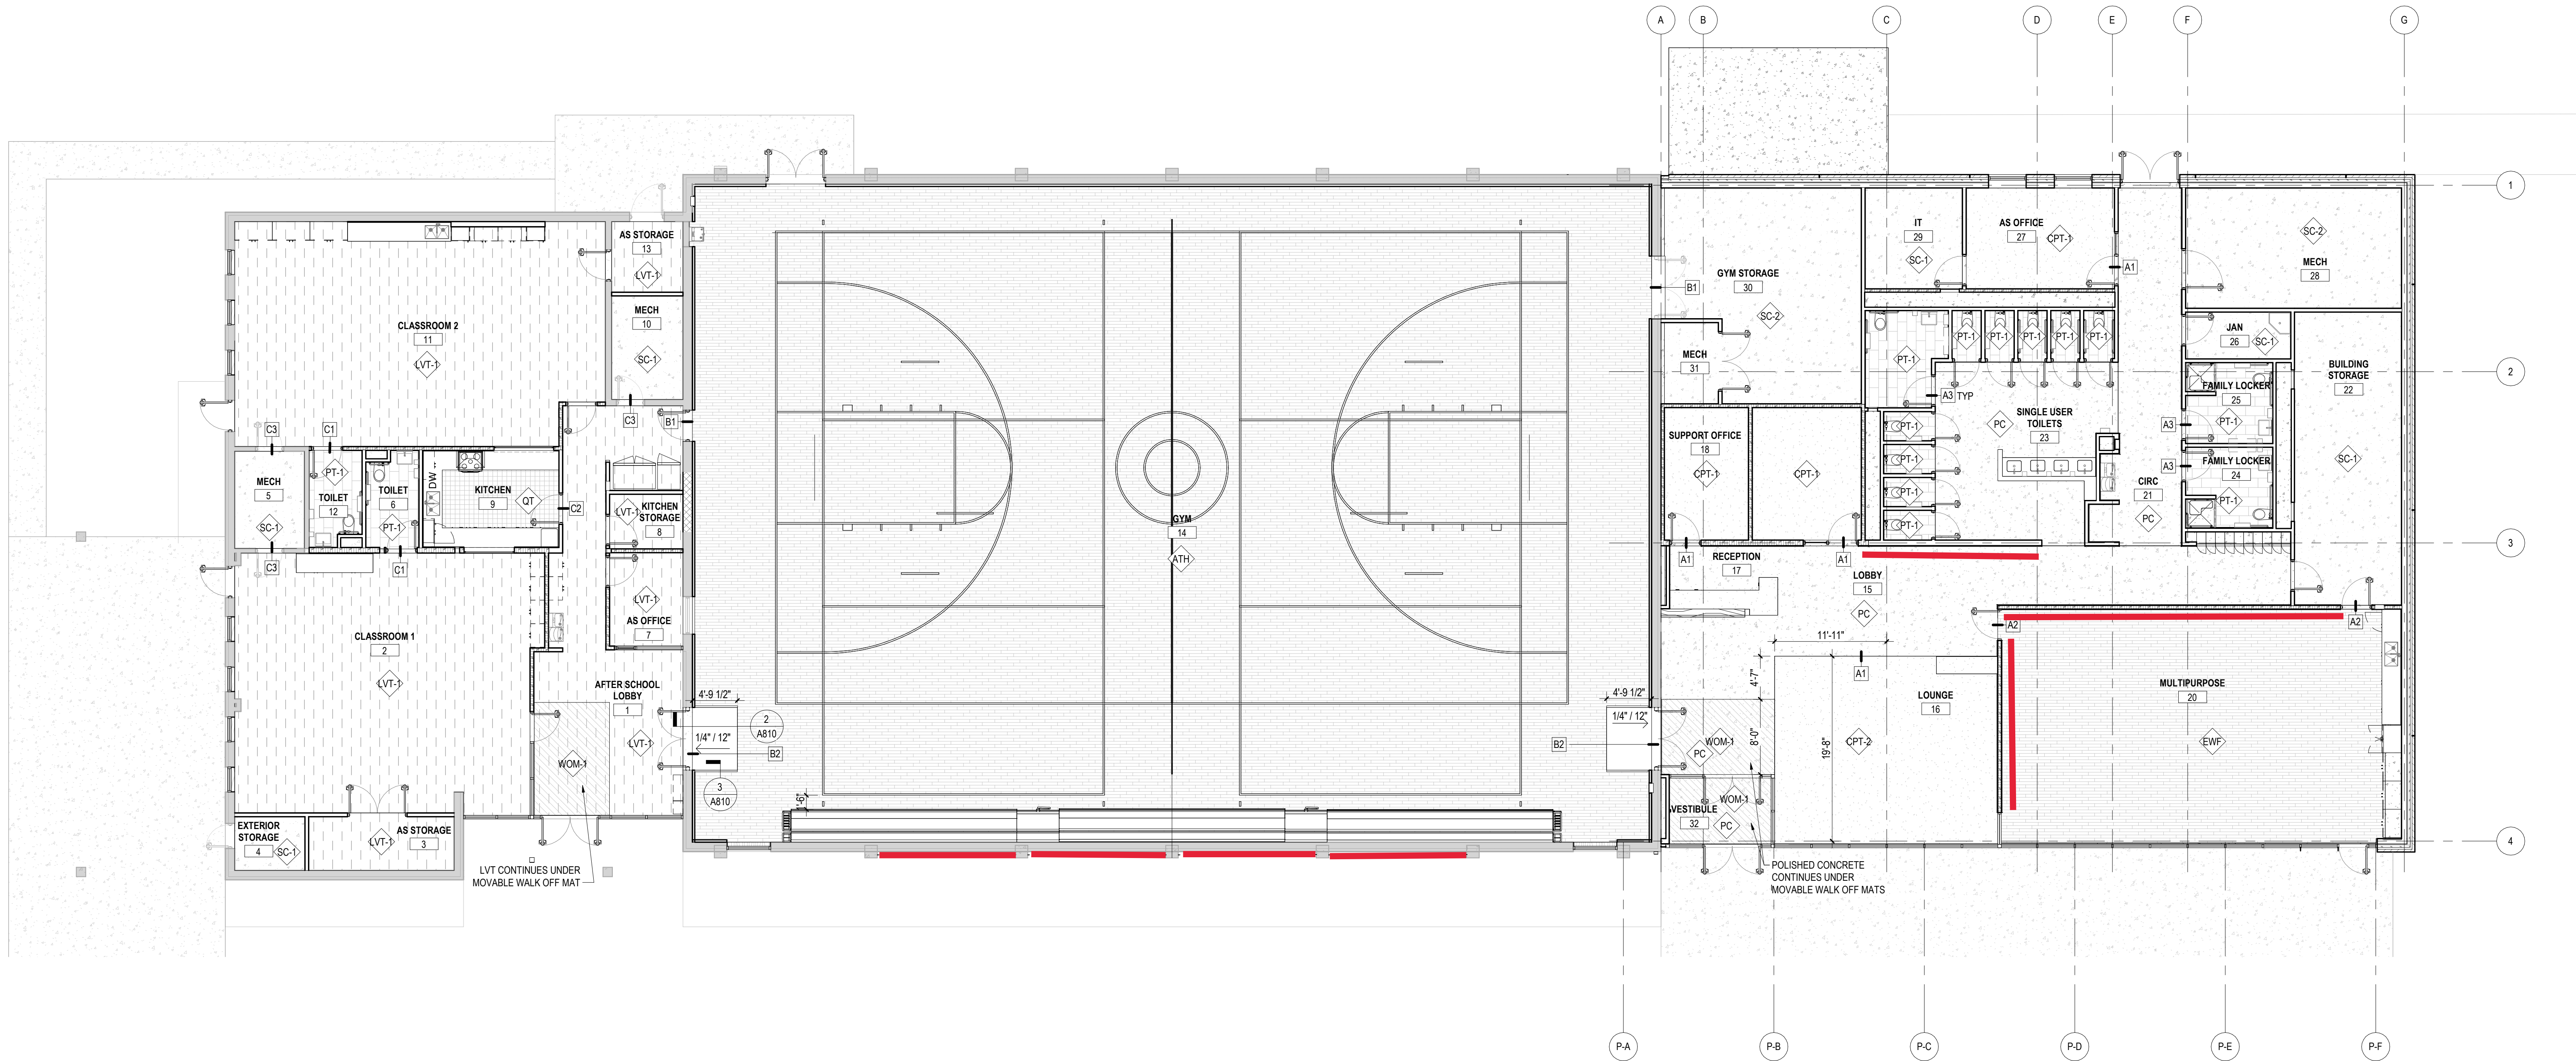
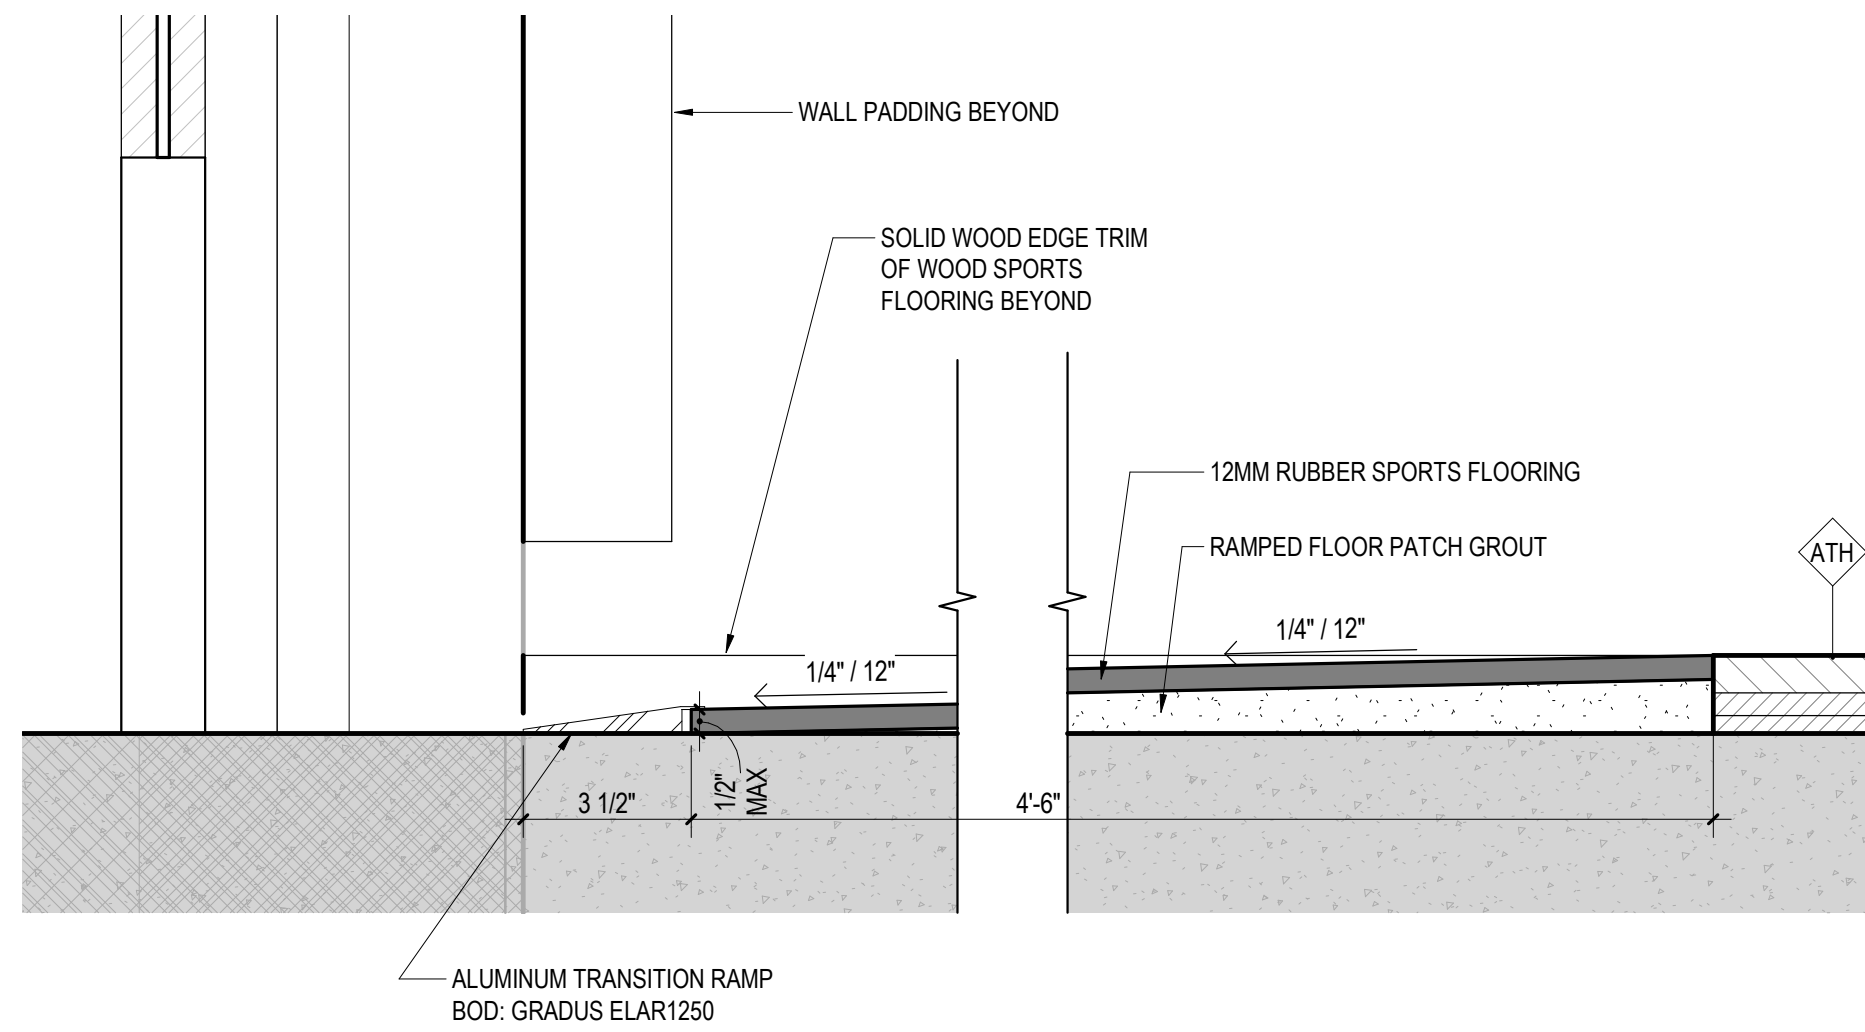
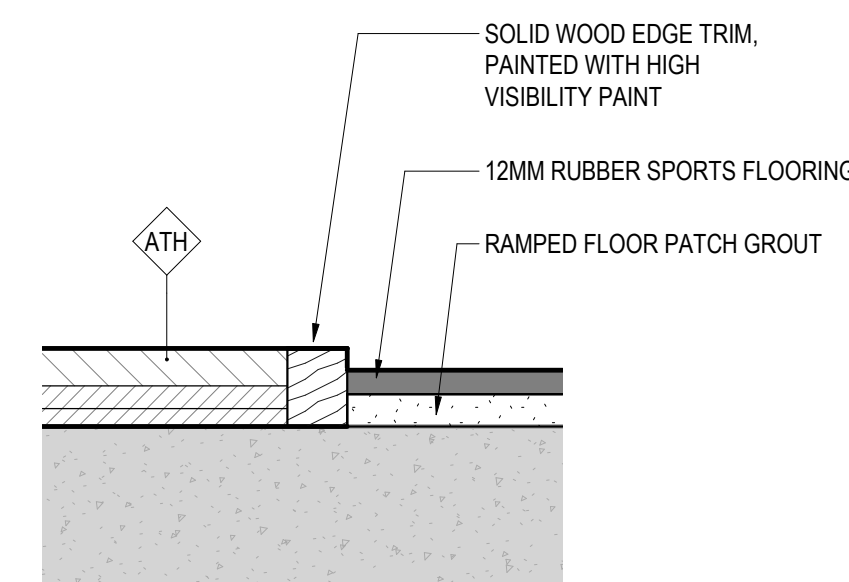
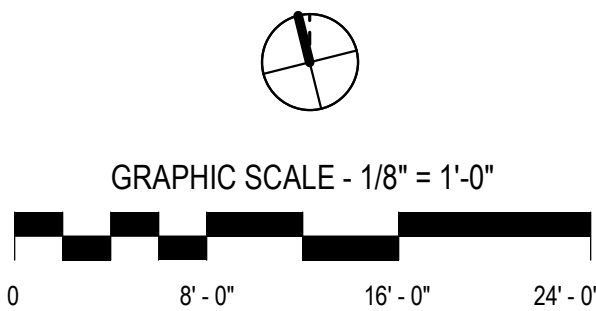


**1**
A301 A810
FINISH PLAN - LEVEL 1
1/8" = 1'-0"**TRANSITION SCHEDULE**

TYPE	DESCRIPTION	PRODUCT	FINISH
A1	PC-1 TO OPT	GRADUS ET359	ALUMINUM CARPET REDUCER 1/4"
A2	PC TO EWF	SCHLUTER RENO RAMP 150 B90	ALUMINUM TRANSITION RAMP
A3	PC TO PT	STONE THRESHOLD	ALUMINUM TRANSITION RAMP
B1	ATH TO SC	DOOR SADDLE TRANSITION 1 5/8" TO 1/2"	STAINLESS STEEL
B2	ATH TO FLUSH	RUBBER FLOOR RAMP TRANSITION 1 5/8" TO 1/2" W/ GRADUS ELAR1250	SEE DETAIL
C1	LVT-1 TO PT-1	STONE THRESHOLD	SLATE THRESHOLD
C2	LVT-1 TO QT	SCHLUTER RENO V	ALUMINUM ADJUSTABLE TRANSITION STRIP
C3	LVT-1 TO SC	GRADUS RAMP TOP PROFILE	ALUMINUM

FINISH PLAN GENERAL NOTES

- FOR ADDITIONAL INFORMATION ON INTERIOR FINISHES, SEE REMAINDER OF DRAWINGS INCLUDING FLOOR PLANS, REFLECTED CEILING PLANS & INTERIOR ELEVATIONS.
- SEE A800 FOR FINISH TYPE DESCRIPTIONS.
- PROVIDE STONE THRESHOLDS AT DOORS OR OPENINGS TO TOILET ROOMS AND BATHROOMS AT TRANSITION BETWEEN CERAMIC TILE AND ADJACENT (OTHER) FLOOR FINISH.
- ALL FLOORS SCHEDULED TO RECEIVE A SEALED CONCRETE FINISH SHALL HAVE TWO (2) COATS OF SEALER. THE SECOND COAT OF SEALER SHALL BE APPLIED AT THE TIME OF SUBSTANTIAL COMPLETION.
- ALL M.E.P. SYSTEMS SHALL BE CONCEALED WITHIN WALL OR CEILING CAVITY, U.N.O.
- PANT ALL STRUCTURE AND INFRASTRUCTURE COMPONENTS AND SURFACES AT OPEN OR EXPOSED CEILINGS.
- ALL INTERIOR FINISHING MUST COMPLY WITH THE APPLICABLE SECTIONS OF CHAPTER 8, INTERIOR FINISHING OF VBC 2021.

**2**
A100 A810
B2 - GYM FLOOR RAMP TRANSITION DETAIL
3" = 1'-0"**3**
A100 A810
B2 - GYM FLOOR RAMP EDGE
3" = 1'-0"

ISSUES AND REVISIONS

NO.	SUBMITTAL	DATE
1	PERMIT SET	01.MAR.24
2	BID SET	10.APR.24